

Approval body for construction products  
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and  
Laender Governments



## European Technical Assessment

ETA-22/0246  
of 3 June 2022

English translation prepared by DIBt - Original version in German language

### General Part

Technical Assessment Body issuing the  
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

CELO Injection system ResiFIX Pure Epoxy for concrete

Product family  
to which the construction product belongs

Bonded fastener for use in concrete

Manufacturer

CELO Befestigungssysteme GmbH  
Industriestraße 6  
86551 Aichach  
DEUTSCHLAND

Manufacturing plant

Werk2, Deutschland

This European Technical Assessment  
contains

24 pages including 3 annexes which form an integral part  
of this assessment

This European Technical Assessment is  
issued in accordance with Regulation (EU)  
No 305/2011, on the basis of

EAD 330499-01-0601, Edition 04/2020

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

## Specific Part

### 1 Technical description of the product

The "CELO Injection system ResiFIX Pure Epoxy for concrete" is a bonded anchor consisting of a cartridge with injection Pure Epoxy EPSF and a steel element. The steel element consists of a commercial threaded rod with washer and hexagon nut in the range of M8 to M30 or reinforcing bar in the range of  $\varnothing$  8 to  $\varnothing$  32 mm.

The steel element is placed into a drilled hole filled with injection mortar and is anchored via the bond between metal part, injection mortar and concrete.

The product description is given in Annex A.

### 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance to tension load (static and quasi-static loading)	See Annex B 2, C 1, C 2, C 3 and C 5
Characteristic resistance to shear load (static and quasi-static loading)	See Annex C 1, C 4 and C 6
Displacements under short-term and long-term loading	See Annex C 7 and C 8
Characteristic resistance and displacements for seismic performance categories C1 and C2	No performance assessed

#### 3.2 Hygiene, health and the environment (BWR 3)

Essential characteristic	Performance
Content, emission and/or release of dangerous substances	No performance assessed

**4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base**

In accordance with the European Assessment Document EAD 330499-01-0601 the applicable European legal act is: [96/582/EC].

The system to be applied is: 1

**5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable European Assessment Document**

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at Deutsches Institut für Bautechnik.


Issued in Berlin 3 June 2022 by Deutsches Institut für Bautechnik

Beatrix Wittstock  
Head of Section


*beglaubigt:*  
Baderschneider

### Installation threaded rod M8 up to M30

prepositioned installation or  
push through installation (annular gap filled with mortar)

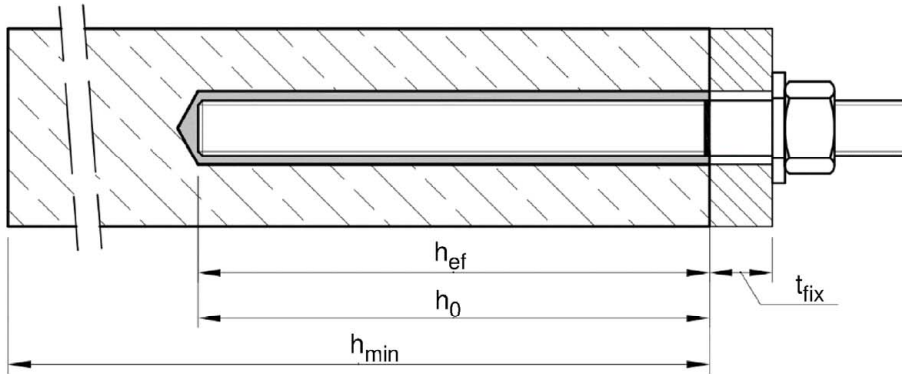

### Installation reinforcing bar Ø8 up to Ø32

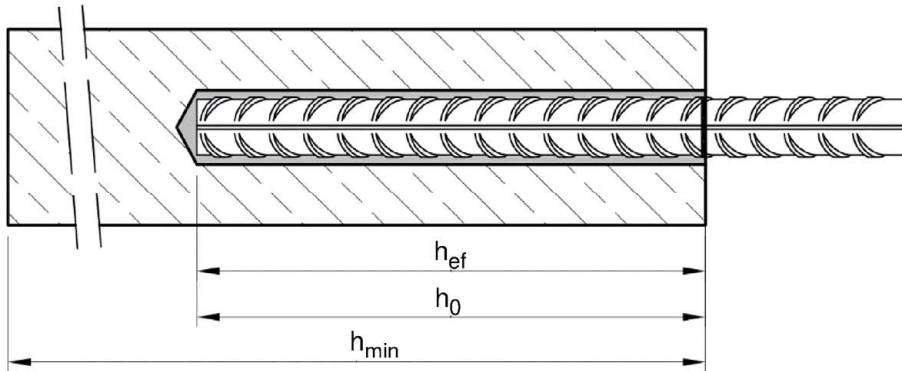

$t_{fix}$  = thickness of fixture

$h_0$  = nominal drill hole diameter

$h_{ef}$  = effective anchorage depth

$h_{min}$  = minimum thickness of member

**CELO Injection system ResiFIX Pure Epoxy for concrete**


**Product description**  
Installed condition

**Annex A 1**


## Cartridge system

### Side-by-Side Cartridge:

440 ml, 585 ml and 1400 ml

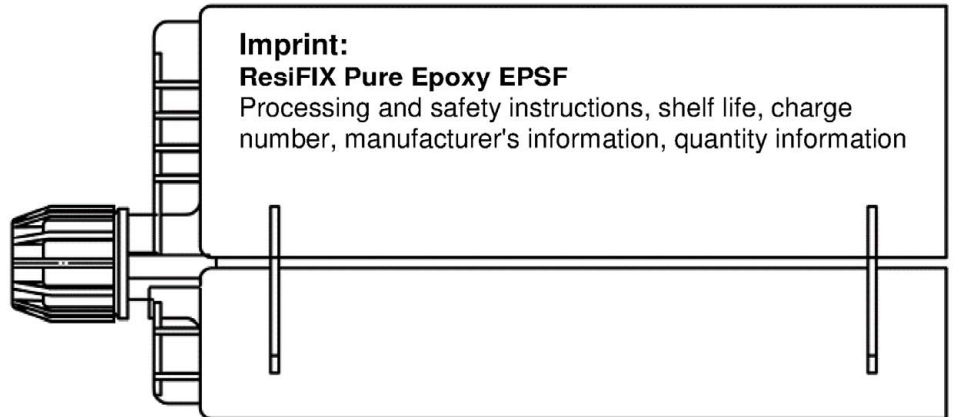

## Static mixer MDE

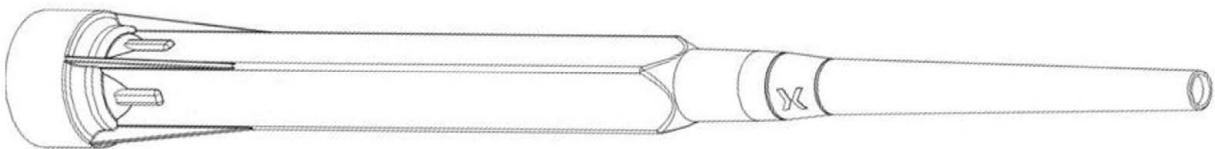

## Piston plug VS and mixer extension VL




CELO Injection system ResiFIX Pure Epoxy for concrete

Product description  
Injection system

Annex A 2

### Threaded rod M8 up to M30 with washer and hexagon nut

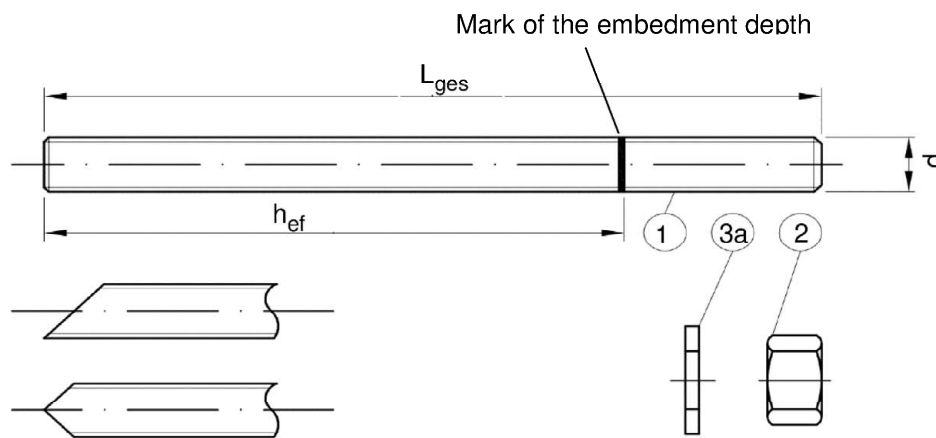

Commercial standard rod with:

- Materials, dimensions and mechanical properties acc. to Table A1
- Inspection certificate 3.1 acc. to EN 10204:2004. The document shall be stored.
- Marking of embedment depth

**CELO Injection system ResiFIX Pure Epoxy for concrete**

**Product description**  
Threaded rod


**Annex A 3**

**Table A1: Materials**

Part	Designation	Material				
<b>Steel, zinc plated</b> (Steel acc. to EN ISO 683-4:2018 or EN 10263:2001) - zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042:2018 or - hot-dip galvanised $\geq 40 \mu\text{m}$ acc. to EN ISO 1461:2009 and EN ISO 10684:2004+AC:2009 or - sherardized $\geq 45 \mu\text{m}$ acc. to EN ISO 17668:2016						
1	Threaded rod	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture	
		acc. to EN ISO 898-1:2013	4.6	$f_{uk} = 400 \text{ N/mm}^2$	$f_{yk} = 240 \text{ N/mm}^2$	$A_5 > 8\%$
			4.8	$f_{uk} = 400 \text{ N/mm}^2$	$f_{yk} = 320 \text{ N/mm}^2$	$A_5 > 8\%$
			5.6	$f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 300 \text{ N/mm}^2$	$A_5 > 8\%$
			5.8	$f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 400 \text{ N/mm}^2$	$A_5 > 8\%$
8.8	$f_{uk} = 800 \text{ N/mm}^2$	$f_{yk} = 640 \text{ N/mm}^2$	$A_5 > 8\%$			
2	Hexagon nut	acc. to EN ISO 898-2:2012	4	for anchor rod class 4.6 or 4.8		
			5	for anchor rod class 5.6 or 5.8		
			8	for anchor rod class 8.8		
3	Washer	Steel, zinc plated, hot-dip galvanised or sherardized (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)				
<b>Stainless steel A2</b> (Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2014) <b>Stainless steel A4</b> (Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014) <b>High corrosion resistance steel</b> (Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014)						
1	Threaded rod <sup>1)2)</sup>	Property class	Characteristic steel ultimate tensile strength	Characteristic steel yield strength	Elongation at fracture	
		acc. to EN ISO 3506-1:2020	50	$f_{uk} = 500 \text{ N/mm}^2$	$f_{yk} = 210 \text{ N/mm}^2$	$A_5 \geq 8\%$
			70	$f_{uk} = 700 \text{ N/mm}^2$	$f_{yk} = 450 \text{ N/mm}^2$	$A_5 > 8\%$
	80	$f_{uk} = 800 \text{ N/mm}^2$	$f_{yk} = 600 \text{ N/mm}^2$	$A_5 > 8\%$		
2	Hexagon nut <sup>1)2)</sup>	acc. to EN ISO 3506-1:2020	50	for anchor rod class 50		
			70	for anchor rod class 70		
			80	for anchor rod class 80		
3	Washer	A2: Material 1.4301 / 1.4307 / 1.4311 / 1.4567 or 1.4541, acc. to EN 10088-1:2014 A4: Material 1.4401 / 1.4404 / 1.4571 / 1.4362 or 1.4578, acc. to EN 10088-1:2014 HCR: Material 1.4529 or 1.4565, acc. to EN 10088-1: 2014 (e.g.: EN ISO 887:2006, EN ISO 7089:2000, EN ISO 7093:2000 or EN ISO 7094:2000)				
1) Property class 70 or 80 for anchor rods and hexagon nuts up to M24 2) Property class 80 only for stainless steel A4 and HCR						
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>					<b>Annex A 4</b>	
<b>Product description</b> Materials threaded rod						



### Reinforcing bar (rebar): $\varnothing 8$ up to $\varnothing 32$

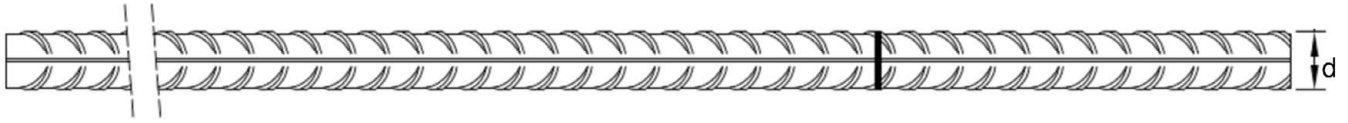

- Minimum value of related rib area  $f_{R,min}$  according to EN 1992-1-1:2004+AC:2010
- Rib height of the bar shall be in the range  $0,05d \leq h_{rib} \leq 0,07d$   
( $d$ : Nominal diameter of the bar;  $h_{rib}$ : Rib height of the bar)

**Table A2: Materials Rebar**

Part	Designation	Material
<b>Rebar</b>		
1	Reinforcing steel according to EN 1992 1 1:2004+AC:2010, Annex C	Bars and rebars from ring class B or C $f_{yk}$ und $k$ according to NDP or NCI according to EN 1992-1-1/NA $f_{uk} = f_{tk} = k \cdot f_{yk}$

**CELO Injection system ResiFIX Pure Epoxy for concrete**

**Product description**  
Reinforcing bar  
Materials reinforcing bar

**Annex A 5**

<b>Specification of the intended use</b>		
<b>Fasteners subject to (Static and quasi-static loads):</b>		
	Working life 50 years	
Base material	Uncracked concrete	Base material
HD: Hammer drilling HDB: Hammer drilling with hollow drill bit CD: Compressed air drilling	M8 bis M30, Ø8 bis Ø32	
DD: Diamond drilling	No performance assessed	
Temperature Range:	I: - 40°C to +40°C <sup>1)</sup> II: - 40°C to +60°C <sup>2)</sup> III: - 40°C to +70°C <sup>3)</sup>	
<p>1) (max. long-term temperature +24°C and max. short-term temperature +40°C)                  2) (max. long-term temperature +35°C and max. short-term temperature +60°C)                  3) (max. long-term temperature +35°C and max. short-term temperature +70°C)</p>		
<b>Base materials:</b>		
<ul style="list-style-type: none"> <li>- Compacted, reinforced or unreinforced normal weight concrete without fibres according to EN 206:2013 + A1:2016.</li> <li>- Strength classes C20/25 to C50/60 according to EN 206:2013 + A1:2016.</li> </ul>		
<b>Use conditions (Environmental conditions):</b>		
<ul style="list-style-type: none"> <li>- Structures subject to dry internal conditions (all materials).</li> <li>- For all other conditions according to EN 1993-1-4:2006+A1:2015 corresponding to corrosion resistance class:                         <ul style="list-style-type: none"> <li>• Stainless steel Stahl A2 according to Annex A 4, Table A1: CRC II</li> <li>• Stainless steel Stahl A4 according to Annex A 4, Table A1: CRC III</li> <li>• High corrosion resistance steel HCR according to Annex A 4, Table A1: CRC V</li> </ul> </li> </ul>		
<b>Design:</b>		
<ul style="list-style-type: none"> <li>- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the fastener is indicated on the design drawings (e. g. position of the fastener relative to reinforcement or to supports, etc.).</li> <li>- Fasteners are designed under the responsibility of an engineer experienced in fasteners and concrete work.</li> <li>- The fasteners are designed in accordance to EN 1992-4:2018 and Technical Report TR 055, Edition February 2018</li> </ul>		
<b>Installation:</b>		
<ul style="list-style-type: none"> <li>- Dry, wet concrete or flooded bore holes (not sea-water).</li> <li>- Hole drilling by hammer (HD), hollow (HDB) or compressed air mode(CD).</li> <li>- Overhead installation allowed.</li> <li>- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site</li> </ul>		
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>		<b>Annex B 1</b>
<b>Intended Use Specifications</b>		

**Table B1: Installation parameters for threaded rod**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
Diameter of element	$d = d_{nom}$	[mm]	8	10	12	16	20	24	27	30
Nominal drill hole diameter	$d_0$	[mm]	10	12	14	18	22	28	30	35
Effective embedment depth	$h_{ef,min}$	[mm]	60	60	70	80	90	96	108	120
	$h_{ef,max}$	[mm]	160	200	240	320	400	480	540	600
Diameter of clearance hole in the fixture	Prepositioned installation $d_f \leq$	[mm]	9	12	14	18	22	26	30	33
	Push through installation $d_f$	[mm]	12	14	16	20	24	30	33	40
Maximum installation torque	$\max T_{inst} \leq$	[Nm]	10	20	40 <sup>1)</sup>	60	100	170	250	300
Minimum thickness of member	$h_{min}$	[mm]	$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$			$h_{ef} + 2d_0$				
Minimum spacing	$s_{min}$	[mm]	40	50	60	75	95	115	125	140
Minimum edge distance	$c_{min}$	[mm]	35	40	45	50	60	65	75	80

<sup>1)</sup> Maximum installation torque for M12 with steel Grade 4.6 is 35 Nm

**Table B2: Installation parameters for reinforcing bar**

Reinforcing bar			$\varnothing 8^1)$	$\varnothing 10^1)$	$\varnothing 12^1)$	$\varnothing 14$	$\varnothing 16$	$\varnothing 20$	$\varnothing 24^1)$	$\varnothing 25^1)$	$\varnothing 28$	$\varnothing 32$
Diameter of element	$d = d_{nom}$	[mm]	8	10	12	14	16	20	24	25	28	32
Nominal drill hole diameter	$d_0$	[mm]	10   12	12   14	14   16	18	20	25	30   32	30   32	35	40
Effective embedment depth	$h_{ef,min}$	[mm]	60	60	70	75	80	90	96	100	112	128
	$h_{ef,max}$	[mm]	160	200	240	280	320	400	480	500	560	640
Minimum thickness of member	$h_{min}$	[mm]	$h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$			$h_{ef} + 2d_0$						
Minimum spacing	$s_{min}$	[mm]	40	50	60	70	75	95	120	120	130	150
Minimum edge distance	$c_{min}$	[mm]	35	40	45	50	50	60	70	70	75	85

<sup>1)</sup> both nominal drill hole diameter can be used

**CELO Injection system ResiFIX Pure Epoxy for concrete**

**Intended Use**  
Installation parameters

**Annex B 2**

**Table B3: Parameter cleaning and setting tools**

Threaded rod	Reinforcing bar	Drill bit - Ø HD, HDB, CD	Brush - Ø		Piston plug	Installation direction and use of piston plug					
			$d_b$	$d_{b,min}$ min. Brush - Ø		↓	→	↑			
[mm]	[mm]	[mm]	[mm]	[mm]							
M8	8	10	RB10	11,5	10,5	No plug required					
M10	8 / 10	12	RB12	13,5	12,5						
M12	10 / 12	14	RB14	15,5	14,5						
	12	16	RB16	17,5	16,5	<table border="1"> <tr> <td><math>h_{ef} &gt; 250 \text{ mm}</math></td> <td><math>h_{ef} &gt; 250 \text{ mm}</math></td> <td>all</td> </tr> </table>			$h_{ef} > 250 \text{ mm}$	$h_{ef} > 250 \text{ mm}$	all
$h_{ef} > 250 \text{ mm}$	$h_{ef} > 250 \text{ mm}$	all									
M16	14	18	RB18	20,0	18,5				VS18		
	16	20	RB20	22,0	20,5				VS20		
M20		22	RB22	24,0	22,5				VS22		
	20	25	RB25	27,0	25,5				VS25		
M24		28	RB28	30,0	28,5				VS28		
M27		30	RB30	31,8	30,5				VS30		
	24 / 25	32	RB32	34,0	32,5				VS32		
M30	28	35	RB35	37,0	35,5				VS35		
	32	40	RB40	43,5	40,5	VS40					

### Cleaning and installation tools

#### HDB – Hollow drill bit system



The hollow drill system consists of Heller Duster Expert Hohlbohrer and a class M Hoover with a minimum negative pressure of 253 hPa and a flow rate of minimum 150 m³/h (42 l/s).

#### Hand pump

(Volumen 750 ml,  $h_0 \geq 10 d_s$ ,  $d_0 \leq 20 \text{ mm}$ )



#### Compressed air tool

(min 6 bar)



#### Brush RB



#### Pistole Plug VS



#### Brush extension RBL



### CELO Injection system ResiFIX Pure Epoxy for concrete

#### Intended Use

Cleaning and setting tools

**Annex B 3**

**Table B4: Working and curing time**

Temperature in base material	Maximum working time	Minimum curing time <sup>1)</sup>
T	t <sub>work</sub>	t <sub>cure</sub>
+ 5 °C to + 9 °C	80 min	60 h
+ 10 °C to + 14 °C	60 min	48 h
+ 15 °C to + 19 °C	40 min	24 h
+ 20 °C to + 24 °C	30 min	12 h
+ 25 °C to + 34 °C	12 min	10 h
+ 35 °C to + 39 °C	8 min	7 h
+ 40 °C	8 min	4 h
Cartridge temperature	+5°C to +40°C	

<sup>1)</sup> The minimum curing time is only valid for dry base material.  
In wet base material the curing time must be doubled.


**CELO Injection system ResiFIX Pure Epoxy for concrete**

**Intended Use**  
Working time and curing time


**Annex B 4**

## Installation instructions

### Drilling of the bore hole

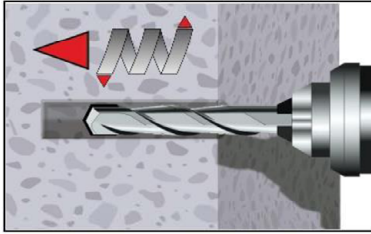

- 1a. Hammer drilling (HD) / Compressed air drilling (CD)  
Drill a hole for the required embedment depth  
Drill bit diameter according to Table B1 or B2. Proceed with Step 2.  
In case of aborted drill hole, the drill hole shall be filled with mortar.

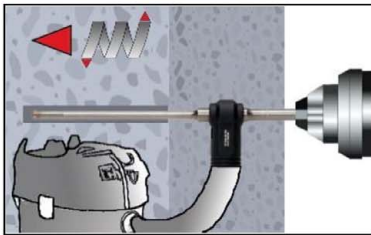


- 1b. Hammer drilling with Hollow drill bit (HDB) (see Annex B 4)  
Drill a hole for the required embedment depth Drill bit diameter according to Table B1 or B2. The hollow drill bit system removes the dust and cleans the bore hole during drilling (all conditions).  
Proceed with Step 3.  
In case of aborted drill hole, the drill hole shall be filled with mortar.


**Attention! Standing water in the bore hole must be removed before cleaning.**

### Manual Air Cleaning (MAC)


for drill hole diameter  $d_0 \leq 20\text{mm}$  and drill hole depth  $h_0 \leq 10d_{\text{nom}}$  (uncracked concrete only!)

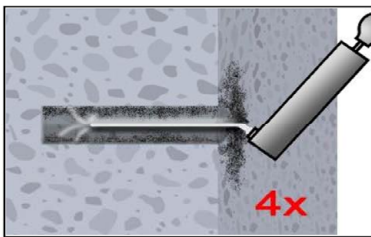

- 2a. Blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 4).

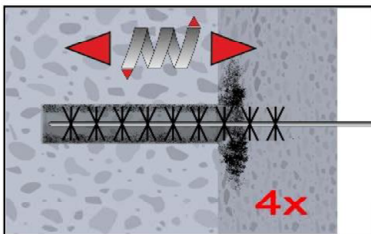


- 2b. Brush the bore hole minimum 4x with brush RB according to Table B3 over the entire embedment depth in a twisting motion (if necessary, use a brush extension RBL).

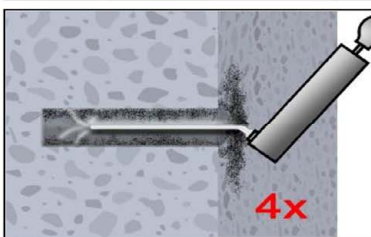

- 2c. Finally blow the bore hole clean minimum 4x from the bottom or back by hand pump (Annex B 4).

### Compressed Air Cleaning (CAC):

All diameter in cracked and uncracked concrete

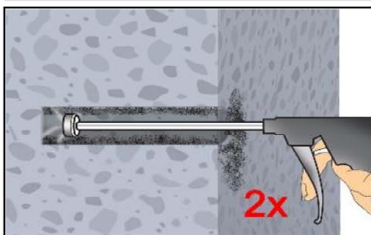

- 2a. Blow the bore hole clean minimum of 2x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)


## CELO Injection system ResiFIX Pure Epoxy for concrete

### Intended Use


Installation instructions

## Annex B 5

**Installation instructions (continuation)**

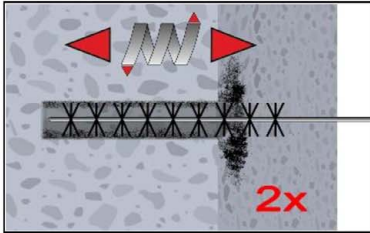


2b. Brush the bore hole minimum 2x with brush RB according to Table B3 over the entire embedment depth in a twisting motion. (If necessary, a brush extension RBL shall be used.)

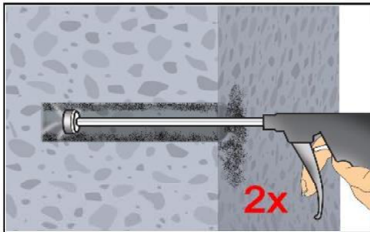


2c. Finally blow the bore hole clean minimum 2x with compressed air (min. 6 bar) (Annex B 4) over the entire embedment depth until return air stream is free of noticeable dust. (If necessary, an extension shall be used.)


**Cleaned bore hole has to be protected against re-contamination in an appropriate way, If necessary, repeat cleaning process directly before dispensing the mortar. In-flowing water must not contaminate the bore hole again.**

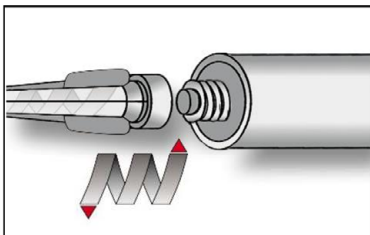


3. Screw on static-mixing nozzle MDE, and load the cartridge into an appropriate dispensing tool.  
For every working interruption longer than the maximum working time  $t_{work}$  (Annex B 4) as well as for new cartridges, a new static-mixer shall be used.

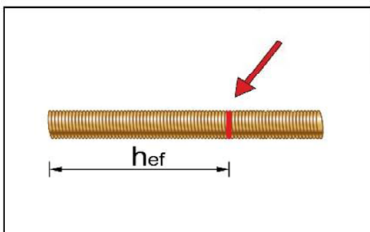

4. Mark embedment depth on the anchor rod.  
The anchor rod shall be free of dirt, grease, oil or other foreign material.

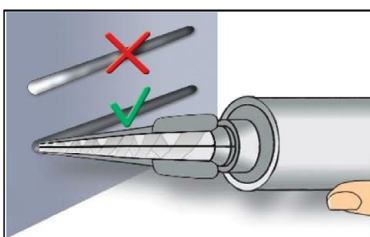

5. Not proper mixed mortar is not sufficient for fastening.  
Dispense and discard mortar until an uniform grey or red colour is shown (at least 3 full strokes).

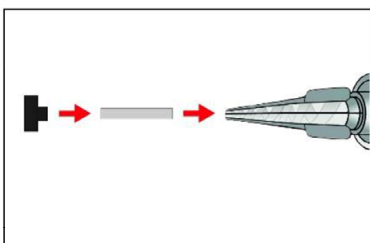

6. Piston plugs VS and mixer nozzle extensions VL shall be used according to Table B4 for the following applications:

- Horizontal and vertical downwards direction: Drill bit- $\varnothing$   $d_0 \geq 18$  mm and embedment depth  $h_{ef} > 250$ mm
- Vertical upwards direction: Drill bit- $\varnothing$   $d_0 \geq 18$  mm


Assemble mixing nozzle, mixer extension and piston plug before injecting mortar.

**CELO Injection system ResiFIX Pure Epoxy for concrete**


**Intended Use**  
Installation instructions (continuation)

**Annex B 6**


**Installation instructions (continuation)**

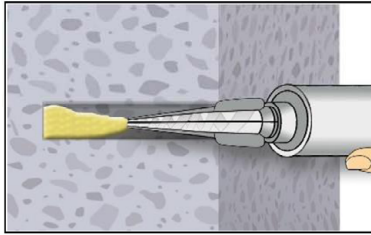


**7a. Injecting mortar without piston plug VS**  
Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.) Slowly withdraw of the static mixing nozzle avoid creating air pockets. Observe the temperature related working time  $t_{work}$  (Annex B 4).

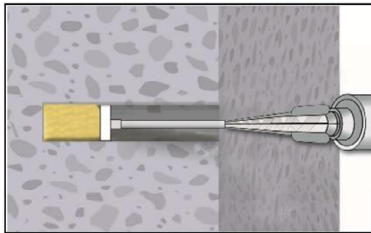


**7b. Injecting mortar with piston plug VS**  
Starting at bottom of the hole and fill the hole up to approximately two-thirds with adhesive. (If necessary, a mixer nozzle extension shall be used.) During injection the piston plug is pushed out of the bore hole by the back pressure of the mortar. Observe the temperature related working time  $t_{work}$  (Annex B 4).

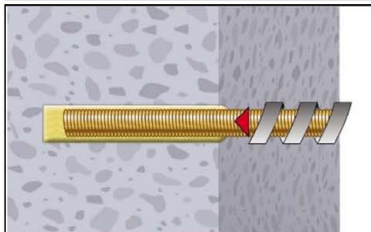


**8.** Insert the anchor rod while turning slightly up to the embedment mark.

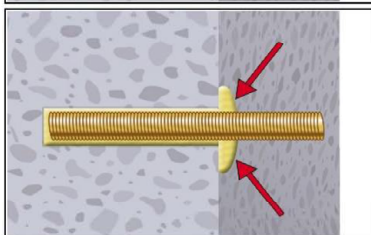


**9.** Annular gap between anchor rod and base material must be completely filled with mortar. In case of push through installation the annular gap in the fixture must be filled with mortar also. Otherwise, the installation must be repeated starting from step 7 before the maximum working time  $t_{work}$  has expired.

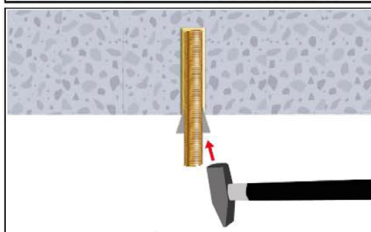

**10.** For application in vertical upwards direction the anchor rod shall be fixed (e.g. wedges).

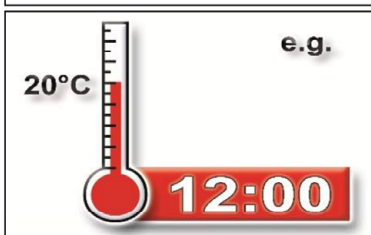

**11.** Temperature related curing time  $t_{cure}$  (Annex B 4) must be observed. Do not move or load the fastener during curing time.

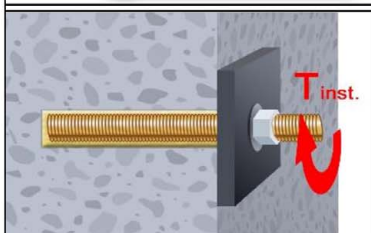

**12.** Install the fixture by using a calibrated torque wrench. Observe maximum installation torque (Table B1).

**CELO Injection system ResiFIX Pure Epoxy for concrete**

**Intended Use**  
Installation instructions (continuation)

**Annex B 7**



**Table C1: Characteristic values for steel tension resistance and steel shear resistance of threaded rods**

Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30	
Cross section area	$A_s$	[mm <sup>2</sup> ]	36,6	58	84,3	157	245	353	459	561	
<b>Characteristic tension resistance, Steel failure <sup>1)</sup></b>											
Steel, Property class 4.6 and 4.8	$N_{Rk,s}$	[kN]	15 (13)	23 (21)	34	63	98	141	184	224	
Steel, Property class 5.6 and 5.8	$N_{Rk,s}$	[kN]	18 (17)	29 (27)	42	78	122	176	230	280	
Steel, Property class 8.8	$N_{Rk,s}$	[kN]	29 (27)	46 (43)	67	125	196	282	368	449	
Stainless steel A2, A4 and HCR, class 50	$N_{Rk,s}$	[kN]	18	29	42	79	123	177	230	281	
Stainless steel A2, A4 and HCR, class 70	$N_{Rk,s}$	[kN]	26	41	59	110	171	247	- <sup>3)</sup>	- <sup>3)</sup>	
Stainless steel A4 and HCR, class 80	$N_{Rk,s}$	[kN]	29	46	67	126	196	282	- <sup>3)</sup>	- <sup>3)</sup>	
<b>Characteristic tension resistance, Partial factor <sup>2)</sup></b>											
Steel, Property class 4.6 and 5.6	$\gamma_{Ms,N}$	[-]	2,0								
Steel, Property class 4.8, 5.8 and 8.8	$\gamma_{Ms,N}$	[-]	1,5								
Stainless steel A2, A4 and HCR, class 50	$\gamma_{Ms,N}$	[-]	2,86								
Stainless steel A2, A4 and HCR, class 70	$\gamma_{Ms,N}$	[-]	1,87								
Stainless steel A4 and HCR, class 80	$\gamma_{Ms,N}$	[-]	1,6								
<b>Characteristic shear resistance, Steel failure <sup>1)</sup></b>											
Without lever arm	Steel, Property class 4.6 and 4.8	$V^0_{Rk,s}$	[kN]	9 (8)	14 (13)	20	38	59	85	110	135
	Steel, Property class 5.6 and 5.8	$V^0_{Rk,s}$	[kN]	11 (10)	17 (16)	25	47	74	106	138	168
	Steel, Property class 8.8	$V^0_{Rk,s}$	[kN]	15 (13)	23 (21)	34	63	98	141	184	224
	Stainless steel A2, A4 and HCR, class 50	$V^0_{Rk,s}$	[kN]	9	15	21	39	61	88	115	140
	Stainless steel A2, A4 and HCR, class 70	$V^0_{Rk,s}$	[kN]	13	20	30	55	86	124	- <sup>3)</sup>	- <sup>3)</sup>
	Stainless steel A4 and HCR, class 80	$V^0_{Rk,s}$	[kN]	15	23	34	63	98	141	- <sup>3)</sup>	- <sup>3)</sup>
With lever arm	Steel, Property class 4.6 and 4.8	$M^0_{Rk,s}$	[Nm]	15 (13)	30 (27)	52	133	260	449	666	900
	Steel, Property class 5.6 and 5.8	$M^0_{Rk,s}$	[Nm]	19 (16)	37 (33)	65	166	324	560	833	1123
	Steel, Property class 8.8	$M^0_{Rk,s}$	[Nm]	30 (26)	60 (53)	105	266	519	896	1333	1797
	Stainless steel A2, A4 and HCR, class 50	$M^0_{Rk,s}$	[Nm]	19	37	66	167	325	561	832	1125
	Stainless steel A2, A4 and HCR, class 70	$M^0_{Rk,s}$	[Nm]	26	52	92	232	454	784	- <sup>3)</sup>	- <sup>3)</sup>
	Stainless steel A4 and HCR, class 80	$M^0_{Rk,s}$	[Nm]	30	59	105	266	519	896	- <sup>3)</sup>	- <sup>3)</sup>
<b>Characteristic shear resistance, Partial factor <sup>2)</sup></b>											
Steel, Property class 4.6 and 5.6	$\gamma_{Ms,V}$	[-]	1,67								
Steel, Property class 4.8, 5.8 and 8.8	$\gamma_{Ms,V}$	[-]	1,25								
Stainless steel A2, A4 and HCR, class 50	$\gamma_{Ms,V}$	[-]	2,38								
Stainless steel A2, A4 and HCR, class 70	$\gamma_{Ms,V}$	[-]	1,56								
Stainless steel A4 and HCR, class 80	$\gamma_{Ms,V}$	[-]	1,33								
<sup>1)</sup> Values are only valid for the given stress area $A_s$ . Values in brackets are valid for undersized threaded rods with smaller stress area $A_s$ for hot-dip galvanised threaded rods according to EN ISO 10684:2004+AC:2009. <sup>2)</sup> In absence of national regulation <sup>3)</sup> Fastener type not part of the ETA											

**CELO Injection system ResiFIX Pure Epoxy for concrete**

**Performances**

Characteristic values for steel tension resistance and steel shear resistance of threaded rods

**Annex C 1**

<b>Table C2: Characteristic values of tension loads</b> under static and quasi-static action				
<b>Fastener</b>		<b>All Fastener type and sizes</b>		
<b>Concrete cone failure</b>				
Uncracked concrete	$k_{ucr,N}$	[-]	11,0	
Cracked concrete	$k_{cr,N}$	[-]	7,7	
Edge distance	$c_{cr,N}$	[mm]	1,5 $h_{ef}$	
Axial distance	$s_{cr,N}$	[mm]	2 $c_{cr,N}$	
<b>Splitting</b>				
Edge distance	$h/h_{ef} \geq 2,0$	$c_{cr,sp}$	[mm]	1,0 $h_{ef}$
	$2,0 > h/h_{ef} > 1,3$			$2 \cdot h_{ef} \left( 2,5 - \frac{h}{h_{ef}} \right)$
	$h/h_{ef} \leq 1,3$			2,4 $h_{ef}$
Axial distance	$s_{cr,sp}$	[mm]	2 $c_{cr,sp}$	
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>			<b>Annex C 2</b>	
<b>Performances</b> Characteristic values of tension loads under static and quasi-static action				

<b>Table C3: Characteristic values of tension loads under static and quasi-static action</b>												
<b>Threaded rod</b>				<b>M8</b>	<b>M10</b>	<b>M12</b>	<b>M16</b>	<b>M20</b>	<b>M24</b>	<b>M27</b>	<b>M30</b>	
<b>Steel failure</b>												
Characteristic tension resistance		$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}$ (or see Table C1)								
Partial factor		$\gamma_{Ms,N}$	[-]	see Table C1								
<b>Combined pull-out and concrete failure</b>												
Characteristic bond resistance in uncracked concrete C20/25												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	15	15	15	14	14	13	13	13
	II: 60°C/35°C				10	10	10	9,5	9,5	9,0	9,0	9,0
	III: 70°C/43°C				7,0	7,0	7,0	6,5	6,5	6,0	6,0	6,0
Characteristic bond resistance in cracked concrete C20/25												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	7,0	7,0	7,0	7,0	7,0	6,0	6,0	6,0
	II: 60°C/35°C				5,0	5,0	5,0	5,0	5,0	4,5	4,5	4,5
	III: 70°C/43°C				3,5	3,5	3,5	3,5	3,5	3,0	3,0	3,0
Reduction factor $\psi_{sus}^0$ in cracked and uncracked concrete C20/25												
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\psi_{sus}^0$	[-]	0,60							
	II: 60°C/35°C				0,60							
	III: 70°C/43°C				0,60							
Increasing factors for concrete		$\psi_c$	[-]	$(f_{ck} / 20)^{0,1}$								
Characteristic bond resistance depending on the concrete strength class		$\tau_{Rk,ucr} =$		$\psi_c \cdot \tau_{Rk,ucr}(C20/25)$								
		$\tau_{Rk,cr} =$		$\psi_c \cdot \tau_{Rk,cr}(C20/25)$								
<b>Concrete cone failure</b>												
Relevant parameter				see Table C2								
<b>Splitting</b>												
Relevant parameter				see Table C2								
<b>Installation factor</b>												
for dry and wet concrete or flooded bore hole		$\gamma_{inst}$	[-]	1,4								
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>										<b>Annex C 3</b>		
<b>Performances</b> Characteristic values of tension loads under static and quasi-static action (Threaded rod)												

<b>Table C4: Characteristic values of shear loads under static and quasi-static action</b>											
<b>Threaded rod</b>			<b>M8</b>	<b>M10</b>	<b>M12</b>	<b>M16</b>	<b>M20</b>	<b>M24</b>	<b>M27</b>	<b>M30</b>	
<b>Steel failure without lever arm</b>											
Characteristic shear resistance Steel, strength class 4.6, 4.8 and 5.6, 5.8	$V^0_{Rk,s}$	[kN]	0,6 · A <sub>s</sub> · f <sub>uk</sub> (or see Table C1)								
Characteristic shear resistance Steel, strength class 8.8 Stainless Steel A2, A4 and HCR, all strength classes	$V^0_{Rk,s}$	[kN]	0,5 · A <sub>s</sub> · f <sub>uk</sub> (or see Table C1)								
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1								
Ductility factor	k <sub>7</sub>	[-]	1,0								
<b>Steel failure with lever arm</b>											
Characteristic bending moment	$M^0_{Rk,s}$	[Nm]	1,2 · W <sub>el</sub> · f <sub>uk</sub> (or see Table C1)								
Elastic section modulus	W <sub>el</sub>	[mm <sup>3</sup> ]	31	62	109	277	541	935	1387	1874	
Partial factor	$\gamma_{Ms,V}$	[-]	see Table C1								
<b>Concrete pry-out failure</b>											
Factor	k <sub>g</sub>	[-]	2,0								
Installation factor	$\gamma_{inst}$	[-]	1,0								
<b>Concrete edge failure</b>											
Effective length of fastener	l <sub>f</sub>	[mm]	min(h <sub>ef</sub> ; 12 · d <sub>nom</sub> )						min(h <sub>ef</sub> ; 300mm)		
Outside diameter of fastener	d <sub>nom</sub>	[mm]	8	10	12	16	20	24	27	30	
Installation factor	$\gamma_{inst}$	[-]	1,0								
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>									<b>Annex C 4</b>		
<b>Performances</b> Characteristic values of shear loads under static and quasi-static action (Threaded rod)											

<b>Table C5: Characteristic values of tension loads under static and quasi-static action</b>														
Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32		
<b>Steel failure</b>														
Characteristic tension resistance	$N_{Rk,s}$	[kN]	$A_s \cdot f_{uk}^{1)}$											
Cross section area	$A_s$	[mm <sup>2</sup> ]	50	79	113	154	201	314	452	491	616	804		
Partial factor	$\gamma_{Ms,N}$	[-]	1,4 <sup>2)</sup>											
<b>Combined pull-out and concrete failure</b>														
Characteristic bond resistance in uncracked concrete C20/25														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,ucr}$	[N/mm <sup>2</sup> ]	14	14	14	12	12	12	12	11	11	11
	II: 60°C/35°C				9,5	9,5	9,5	8,5	8,5	8,5	7,5	7,5	7,5	7,5
	III: 70°C/43°C				6,0	6,0	6,0	6,0	6,0	5,5	5,5	5,5	5,0	5,0
Characteristic bond resistance in cracked concrete C20/25														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\tau_{Rk,cr}$	[N/mm <sup>2</sup> ]	6,0	7,0	7,0	6,5	6,5	6,0	6,0	6,0	5,5	5,5
	II: 60°C/35°C				4,0	4,5	4,5	4,5	4,0	4,0	4,0	4,0	3,5	3,5
	III: 70°C/43°C				2,5	2,5	2,5	2,5	2,5	2,5	2,5	2,5	2,5	2,5
Reduction factor $\psi_{sus}^0$ in cracked and uncracked concrete C20/25														
Temperature range	I: 40°C/24°C	Dry, wet concrete and flooded bore hole	$\psi_{sus}^0$	[-]	0,60									
	II: 60°C/35°C				0,60									
	III: 70°C/43°C				0,60									
Increasing factors for concrete	$\psi_c$	[-]	$(f_{ck} / 20)^{0,1}$											
Characteristic bond resistance depending on the concrete strength class	$\tau_{Rk,ucr} =$		$\psi_c \cdot \tau_{Rk,ucr}(C20/25)$											
	$\tau_{Rk,cr} =$		$\psi_c \cdot \tau_{Rk,cr}(C20/25)$											
<b>Concrete cone failure</b>														
Relevant parameter	see Table C2													
<b>Splitting</b>														
Relevant parameter	see Table C2													
<b>Installation factor</b>														
for dry and wet concrete or flooded bore hole	$\gamma_{inst}$	[-]	1,4											
<sup>1)</sup> $f_{uk}$ shall be taken from the specifications of reinforcing bars <sup>2)</sup> In absence of national regulation														
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>											<b>Annex C 5</b>			
<b>Performances</b> Characteristic values of tension loads under static and quasi-static action (Reinforcing bar)														

<b>Table C6: Characteristic values of shear loads under static and quasi-static action</b>													
Reinforcing bar		Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32		
<b>Steel failure without lever arm</b>													
Characteristic shear resistance	$V_{Rk,s}^0$	[kN]	$0,5 \cdot A_s \cdot f_{uk}^{1)}$										
Cross section area	$A_s$	[mm <sup>2</sup> ]	50	79	113	154	201	314	452	491	616	804	
Partial factor	$\gamma_{Ms,V}$	[-]	1,5 <sup>2)</sup>										
Ductility factor	$k_7$	[-]	1,0										
<b>Steel failure with lever arm</b>													
Characteristic bending moment	$M_{Rk,s}^0$	[Nm]	$1.2 \cdot W_{el} \cdot f_{uk}^{1)}$										
Elastic section modulus	$W_{el}$	[mm <sup>3</sup> ]	50	98	170	269	402	785	1357	1534	2155	3217	
Partial factor	$\gamma_{Ms,V}$	[-]	1,5 <sup>2)</sup>										
<b>Concrete pry-out failure</b>													
Factor	$k_8$	[-]	2,0										
Installation factor	$\gamma_{inst}$	[-]	1,0										
<b>Concrete edge failure</b>													
Effective length of fastener	$l_f$	[mm]	$\min(h_{ef}; 12 \cdot d_{nom})$						$\min(h_{ef}; 300\text{mm})$				
Outside diameter of fastener	$d_{nom}$	[mm]	8	10	12	14	16	20	24	25	28	32	
Installation factor	$\gamma_{inst}$	[-]	1,0										
<p>1) <math>f_{uk}</math> shall be taken from the specifications of reinforcing bars</p> <p>2) in absence of national regulation</p>													
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>										<b>Annex C 6</b>			
<b>Performances</b> Characteristic values of shear loads under static and quasi-static action (Reinforcing bar)													

<b>Table C7: Displacements under tension load<sup>1)</sup></b>										
Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
<b>Uncracked concrete under static and quasi-static action</b>										
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,028	0,029	0,030	0,033	0,035	0,038	0,039	0,041
Temperature range II: 60°C/35°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,038	0,039	0,040	0,044	0,047	0,051	0,052	0,055
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,047	0,049	0,051	0,055	0,059	0,064	0,067	0,070
Temperature range III: 70°C/43°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,042	0,043	0,044	0,048	0,052	0,056	0,057	0,061
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,052	0,054	0,056	0,061	0,065	0,070	0,074	0,077
<b>Cracked concrete under static and quasi-static action</b>										
Temperature range I: 40°C/24°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,069	0,071	0,072	0,074	0,076	0,079	0,081	0,082
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,193	0,115	0,122	0,128	0,135	0,142	0,155	0,171
Temperature range II: 60°C/35°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,092	0,095	0,096	0,099	0,102	0,106	0,109	0,110
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,259	0,154	0,163	0,172	0,181	0,189	0,207	0,229
Temperature range III: 70°C/43°C	$\delta_{N0}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,101	0,105	0,106	0,109	0,112	0,117	0,120	0,121
	$\delta_{N\infty}$ -factor	[mm/(N/mm <sup>2</sup> )]	0,285	0,169	0,179	0,189	0,199	0,208	0,228	0,252
<sup>1)</sup> Calculation of the displacement $\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau$ ; $\tau$ : action bond stress for tension $\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau$ ;										
<b>Table C8: Displacements under shear load<sup>1)</sup></b>										
Threaded rod			M8	M10	M12	M16	M20	M24	M27	M30
<b>Uncracked and cracked concrete under static and quasi-static action</b>										
All temperature ranges	$\delta_{V0}$ -factor	[mm/kN]	0,06	0,06	0,05	0,04	0,04	0,03	0,03	0,03
	$\delta_{V\infty}$ -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05
<sup>1)</sup> Calculation of the displacement $\delta_{V0} = \delta_{V0}\text{-factor} \cdot V$ ; $V$ : action shear load $\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V$ ;										
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>									<b>Annex C 7</b>	
<b>Performances</b> Displacements under static and quasi-static action (threaded rod)										

<b>Table C9: Displacements under tension load<sup>1)</sup></b>												
Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
<b>Uncracked concrete under static and quasi-static action</b>												
Temperature range I: 40°C/24°C	δ <sub>N0</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,028	0,029	0,030	0,031	0,033	0,035	0,038	0,038	0,040	0,043
	δ <sub>N∞</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,015	0,015	0,016	0,017	0,017	0,019	0,020	0,020	0,021	0,023
Temperature range II: 60°C/35°C	δ <sub>N0</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,038	0,039	0,040	0,042	0,044	0,047	0,051	0,051	0,054	0,058
	δ <sub>N∞</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,047	0,049	0,051	0,053	0,055	0,059	0,065	0,065	0,068	0,072
Temperature range III: 70°C/43°C	δ <sub>N0</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,042	0,043	0,044	0,046	0,048	0,052	0,056	0,056	0,059	0,064
	δ <sub>N∞</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,052	0,054	0,056	0,058	0,061	0,065	0,072	0,072	0,075	0,079
<b>Cracked concrete under static and quasi-static action</b>												
Temperature range I: 40°C/24°C	δ <sub>N0</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,069	0,071	0,072	0,073	0,074	0,076	0,079	0,079	0,081	0,084
	δ <sub>N∞</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,115	0,122	0,128	0,135	0,142	0,155	0,171	0,171	0,181	0,194
Temperature range II: 60°C/35°C	δ <sub>N0</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,092	0,095	0,096	0,098	0,099	0,102	0,106	0,106	0,109	0,113
	δ <sub>N∞</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,154	0,163	0,172	0,181	0,189	0,207	0,229	0,229	0,242	0,260
Temperature range III: 70°C/43°C	δ <sub>N0</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,101	0,105	0,106	0,108	0,109	0,112	0,117	0,117	0,120	0,124
	δ <sub>N∞</sub> -factor	[mm/(N/mm <sup>2</sup> )]	0,169	0,179	0,189	0,199	0,208	0,228	0,252	0,252	0,266	0,286
1) Calculation of the displacement $\delta_{N0} = \delta_{N0}\text{-factor} \cdot \tau;$ <span style="margin-left: 200px;">τ: action bond stress for tension</span> $\delta_{N\infty} = \delta_{N\infty}\text{-factor} \cdot \tau;$												
<b>Table C10: Displacements under shear load<sup>1)</sup></b>												
Reinforcing bar			Ø 8	Ø 10	Ø 12	Ø 14	Ø 16	Ø 20	Ø 24	Ø 25	Ø 28	Ø 32
<b>Uncracked and cracked concrete under static and quasi-static action</b>												
All temperature ranges	δ <sub>V0</sub> -factor	[mm/kN]	0,06	0,05	0,05	0,04	0,04	0,04	0,03	0,03	0,03	0,03
	δ <sub>V∞</sub> -factor	[mm/kN]	0,09	0,08	0,08	0,06	0,06	0,05	0,05	0,05	0,04	0,04
1) Calculation of the displacement $\delta_{V0} = \delta_{V0}\text{-factor} \cdot V;$ <span style="margin-left: 200px;">V: action shear load</span> $\delta_{V\infty} = \delta_{V\infty}\text{-factor} \cdot V;$												
<b>CELO Injection system ResiFIX Pure Epoxy for concrete</b>										<b>Annex C 8</b>		
<b>Performances</b> Displacements under static and quasi-static action (reinforcing bar)												